

# **Operating & Instruction Manual**



Making the Invisible Visible®





# **Operating & Instruction Manual**

GENERAL DESCRIPTION
POINTS TO UNDERSTAND BEFORE PROCEEDING 5
SAFETY6
WARNING
HOW IT WORKS
A WORD ABOUT ELECTRIC FIELDS9-12
LIMITATIONS FOR USE
INSTRUCTIONS FOR USE
HOW TO WEAR IT16
WHEN AND HOW TO USE IT16-18
TECHNICAL SPECIFICATIONS19-20
WARNING DISTANCE CHARTS
TERMS AND CONDITIONS OF SALE23-24

For the latest information on V-Watch Personal Voltage Detectors including product updates and technical information, visit our website at HDElectricCompany.com

# GENERAL DESCRIPTION

The V-Watch® Personal Voltage Detector detects the strong electric fields surrounding high voltage conductors and power distribution equipment. It is a small pocket size device worn on the outside of the clothing or other protective gear by users operating near power lines or high voltage equipment. It provides an extra level of safety for personnel trained in the use and application while working on or near high voltage systems.



# The V-Watch Personal Voltage Detector detects electric fields. Make sure you understand these points before proceeding:

- · Electric fields surround every energized AC conductor.
- The closer you are to a conductor, the stronger the field will be.
- Higher voltage means a stronger electric field and a greater warning distance. Lower voltage means a reduced warning distance.
- · Electric fields are NOT blocked by plastics, dry wood or clothing.
- Electric fields ARE blocked by ANY conductor such as a metal cabinet or door, wet wood, metal fences, green trees, a growing shrub or hedge and tall wet grass.
- The detector will not find cables buried under the ground.
   The ground is a conductor and will block electric fields.
- Insulation on a wire does not block the electric field and does not affect warning distances.
- Underground primary cables are both insulated AND shielded. The shield is a conductor, is grounded, and will block the electric field.
- Molded cable terminators such as elbows are, like the cables they are installed on, both insulated and shielded and will block electric fields.
- Your body will block electric fields. Wear the detector front and center and do not walk backwards.
- Do not use the detector while holding it in your hand.
   Wrapping your fingers around the device will block electric fields, preventing it from working properly.

#### SAFETY

- Always use proper high voltage procedures, including personal protective equipment, when working near or around high voltage equipment or conductors.
- Do not rely on the detector as your sole source of high voltage detection. Risk of electrocution is inherent in or around high voltage.
- Never contact high voltage with the V-Watch detector.
- Always use proper high voltage procedures for testing and grounding.
- Because the human body is a good electrical conductor, electric fields are distorted or blocked by the body. Thus, positioning of the detector on the body and its location relative to the voltage source can have a large effect on its sensitivity to electric fields.
- Grounded equipment can appear to be live in close proximity to energized conductors.
- The V-Watch Personal Voltage Detector is not sensing electric fields when it is closed.

#### WARNING



# NOT FOR USE BELOW 2400 VOLTS AC.

#### OPERATIONAL IMPAIRMENT

If the detector is used in a manner not described in this instruction manual, the protection and effective operation of this equipment may be impaired.

The detector will not detect DC voltage or stored charge such as in charged capacitors or underground cable. When the detector is closed, it will not detect or warn of nearby high voltage. Always use proper high voltage procedures, including personal protective equipment, when working near or around high voltage equipment or conductors. Never contact high voltage. Always use proper high voltage procedures for testing and grounding. Do not rely on the V-Watch Personal Voltage Detector as your sole source of high voltage detection. Risk of electrocution is inherent in or around high voltage.

#### HOW IT WORKS

The V-Watch Personal Voltage Detector works by sensing the presence of the electric field surrounding anything that conducts high voltage electricity and sounding an alarm. It measures the strength of the electric field; a higher voltage or stronger field will cause the detector to alarm from a greater distance.


It emits a series of loud beeps and flashing lights when an electric field is first detected. The beeps and flashing lights increase in frequency as the user approaches the source of the high voltage electric field. A steady alternating tone and flashing lights indicates very close proximity to high voltage and the need for extreme caution. This variable beeping rate helps the user to determine if they are approaching the high voltage source or moving away from it to safety.

The detector tests itself automatically each time it is opened. A successful self test is confirmed by a series of tones and flashing lights. A failed test is indicated by a solid error tone and no lights. A low battery alarm is a slow alternating tone and flashing red lights. The unit will shut off when it is closed and this is verified by descending tones.

For more information, refer to the A Word About Electric Fields section on page 9.

#### A WORD ABOUT ELECTRIC FIELDS

Electric fields surround
every energized conductor.
The V-Watch Personal Voltage
Detector measures the
strength of these electric
fields to warn the user when
fields are strong enough
to indicate the presence
of nearby high voltage
conductors.




A downed power line is a typical hazardous situation where the detector can provide a warning. This power line lying on the ground sets up a high voltage field surrounding the conductor that the detector will sense and warn the user.

The detector is designed to be worn on the body and it measures the electrical fields typically found in close proximity to the body. Because the human body is a good electrical conductor, electric fields are distorted or even blocked by the body. Thus, positioning of the detector on the body and its location relative to the voltage source can have a large effect on its sensitivity to electric fields.

When properly worn on the front of the body, as shown, and with the user facing a waist height energized conductor, such as a terminal on a pad mount transformer or switch, the detector will start to alarm about 10 feet from a 7kV conductor. If the

user were to approach this energized terminal by backing up to it, the warning distance may be reduced to 3 feet or less.

If the user bends over from the waist to reach towards an energized high voltage terminal, the warning distance may also be significantly reduced. In both cases, the high conductivity of the body acts as a shield to conduct the electric field around the detector.





The V-Watch Personal Voltage Detector measures only the strength of the electric field. It cannot directly measure distance to the source of the electric field such as an energized conductor. The higher the voltage, the stronger the field and the greater the alarm

distance. The reverse is also true; the detector may alarm due to the very close proximity of low voltage when the user walks past a typical factory machine such as a running drill press, an office computer terminal or a desk lamp. It may even alarm if it is placed up against a typical 120 volt wall outlet.

Electrically conductive objects located underneath power lines can appear to be live. A metal fence or a growing hedge can cause a distortion of the electric field under these lines and result in high electric field strength near the ground. The V-Watch Personal Voltage Detector will provide an early warning of high electric

warning of high electrifields, but not all fields are directly caused by nearby energized objects. To prevent the detector from issuing too many false alarms, it should not be used or worn in typical office or factory environments where all the equipment is low

environments where all the equipment is low voltage and there is no danger of contacting energized high voltage conductors.

Fence May

**Appear** 

To Be "Live"

As an additional protection against false alarms from transient voltages, the detector has a built-in time delay and may take up to one second to emit an alarm warning of high voltage. For this reason, a user running towards an energized high voltage source may find the warning distance reduced.




#### LIMITATIONS FOR USE



# WARNING: Conductors lying on the ground or very close to it will result in reduced warning distances.



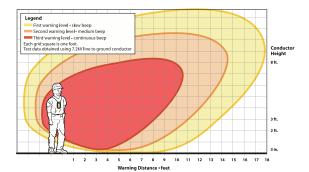

Conductors of different phases in close proximity will also reduce warning distances due to field cancellation effects

Wearing the V-Watch Personal Voltage Detector in environments such as substations or under transmission lines may result in the detector alarming continuously.



Be aware of unique conditions that may be present around three phase delta systems.

Unlike grounded Y systems, a single phase of a delta system can become grounded without causing an

outage and the delta system can continue to operate with this grounded phase. If this phase is grounded as a result of a downed conductor or other storm damage. it may be grounded only temporarily and could become reenergized if moved or disturbed. The V-Watch Personal Voltage Detector will not detect any grounded conductor, whether it is a grounded delta phase conductor, a guy wire or a pole ground.



WARNING: Treat all conductors as live unless or until there is a visible break from a live source and a ground is in place.

### INSTRUCTIONS FOR USE



# NOT FOR USE BELOW 2400 VOLTS AC.

Before using, read the entire instruction manual and review product labeling. Pull the top of the unit up to verify a good battery and to perform a self test. The test circuitry generates an internal voltage which the detector then detects and indicates by turning on the lights and sounding the beeper. DO NOT USE the detector if the self test error tone is heard or if the detector fails to activate the lights and beeper. Remove from service and contact the factory to arrange for repair.

The detector should always be worn facing any potential high voltage electricity. Wear the detector in the center of the front of your body as shown on page 17 and always wear in the direction of movement or work. Do not walk backwards or sideways when wearing the detector as it will not detect high voltage behind you or as effectively to the sides. Wear on the outside of all clothing. Keep it away from all other large metal objects such as belt buckles, tool belts or electronic items such as radios, pagers, cell phones or any other electrical devices which may interfere with the detector.

The detector will emit a series of beeps and flashing lights when it detects high voltage. It will beep and flash faster as it gets closer to high voltage. Very rapid beeping and flashing or a constant alternating tone and lights indicates close proximity to high voltage and requires extreme caution.

#### V-Watch® Personal Voltage Detector

Read instructions before use. Pull open to use and verify self test. Wear outside of all clothing and away from metal objects. Place on front of body in direction of work, this side towards body. Use with extreme caution as high voltage may be nearby.

**WARNING:** Do not rely on this device as your only indication of high voltage.

**DANGER:** Lights and beeper indicate proximity to high voltage and associated risks of arcing and electrocution.

Contains FCC ID: T9JRN4020 www.HDElectricCompany.com VWS-20 12/17

#### HOW TO WEAR IT

The V-Watch Personal Voltage Detector should always be worn mid-torso on the front of the body and face in

the direction of movement.

Because it is sensitive to electric fields in front of the user, and to a lesser extent on either side, proper positioning is important. Adjust the lanyard so that the detector is located at mid torso and facing forward. The clip on the back of the unit can provide additional support by clipping to a shirt front or safety vest.



#### WHEN AND HOW TO USE IT

The V-Watch Personal Voltage Detector can be used anytime, anyplace and for any reason. The decision of when to use it is made by the user and by your company's safety and work practices.

When used properly, the detector can provide an additional warning to users exposed or working around energized high voltage electricity and equipment. Awareness of the presence of a high voltage electric field allows the user to take additional precautions against accidental contact with energized equipment. The variable frequency beeping gives the user an indication of the source and direction of the high voltage.

The detector provides an early warning of the proximity of potentially hazardous high voltage electricity and equipment. It will start to beep with flashing lights slowly as an electric field is first detected and will then beep faster, increasing to a steady

alternating tone and flashing lights if the user continues to approach the source of the high voltage electric field. A steady alternating tone and flashing lights indicates the need for extreme caution, as the source of the high voltage electric field is

close.



When the V-Watch Personal Voltage Detector is in use with a good working battery, it is always on, always ready to warn of potentially hazardous high voltage. The battery life is approximately six months of continuous use or two years in storage. When the job requiring the protection of the detector for the user is completed, the detector should be closed by pushing down on the top.



**CAUTION:** The V-Watch Personal Voltage Detector is not sensing electric fields when it is closed.

# BATTERY REPLACEMENT INSTRUCTIONS

A low battery is indicated by red flashing lights and a slow alternating tone. Always replace all three AAA batteries at the same time, either three alkaline or three lithium types as specified below.

To access the battery compartment, turn the V-Watch detector off by pushing the top down. The battery compartment is on the back of the unit. Rotate the belt clip sideways and then remove the battery compartment cover. Note the battery polarity which is also printed inside the unit.



After installing the new batteries, replace the battery cover and turn the V-Watch detector on by pulling

the top up. A successful self test is indicated by a tone series and flashing lights. If the self test is not successful, do not use the V-Watch detector and return it to the factory for service.



#### **CLEANING**

To clean, wipe with a damp cloth with water. Do not use harsh chemicals or solvents.

#### TECHNICAL SPECIFICATIONS

SENSITIVITY: Factory set at 50/60 Hz sensing threshold (first beep). The detector will only detect AC voltage. Do not use below 2400 Volts.

TYPICAL WARNING DISTANCE: 7 feet (2.13m) from

a 4kV AC conductor.

**OPERATING FREQUENCY: 50Hz/60Hz** 

BATTERY: Three AAA alkaline batteries ANSI-24A,

IEC-LR03 or lithium ANSI 24-LF, IECFR03.

Life 2 years in storage, six months of continuous use.

BEEPER SOUND PRESSURE LEVEL: 100 db. WEIGHT WITH BATTERY: 7.97 oz (226q)

DIMENSIONS:

Closed: 5.53" (14.0cm) x 3.54" (9.0cm) x 1.42" (3.6cm) Open: 6.29" (15.9cm) x 3.54" (9.0cm) x 1.42" (3.6cm)

VOLTAGE RANGE: 2400VAC and above. ENCLOSURE MATERIAL: ABS UL 94-HB. PRINTED CIRCUIT BOARDS: FR-4 UL94V-0.

#### **ENVIRONMENTAL CONDITIONS**

CONDITIONS: Indoor and outdoor use, IP 63

ALTITUDE: Up to 6,566 ft. (2000M)

OPERATING TEMPERATURE: -20°F to +120°F

(-29°C to +49°C)

HUMIDITY: 95% to 49°C (non-condensing)

OVERVOLTAGE CATEGORY: II Non-contact

**POLLUTION DEGREE: PD4** 

## MANUFACTURING LOCATION


HD Electric • Southaven, MS. 38672, USA

REPAIRS If any damage is found please contact us at 800-435-0786 to arrange for service.

#### **ACCESSORIES**

V-Watch Personal Voltage Detectors come standard with three AAA lithium batteries, padded carrying bag and instruction manual.

#### V-WATCH DETECTOR WARNING DISTANCES

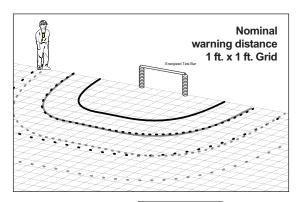

#### **Test Details**

All of the warning distances are shown on a 1 foot grid and all distances are to scale.


Voltage: 2.4	kV Line-Ground	1	
Location	Slow Beep	Medium Beep	Fast Beep
Side of Bar	11.5 ft.	8 ft.	5.5 ft.
End of Bar	9 ft.	6 ft.	3.5 ft.

End of Bar	9 ft.	6 ft.	3.5 ft.				
Test Voltage	Test Voltage 7.2kV Line-Ground						
Location	Slow Beep	Medium Beep	Fast Beep				
Side of Bar	15.5.0	11.6	8.6				

The energized bar is 4 feet long and 30 inches above the ground on insulators. It is energized from behind and the indicated voltage is line to ground.

For this test, the V-Watch Detector was worn on the shirt front as pictured. Warning distances will be reduced slightly if it is worn on the belt and will be reduced substantially if an arm is extended toward the energized source or if the user approaches the energized source backwards.

#### V-WATCH DETECTOR WARNING DISTANCES



#### **Test Details**

All of the warning distances are shown on a 1 foot grid and all distances are to scale.

Test Voltag	e 19.9kV Line-C	Fround	
Location	Slow Beep	Medium Beep	Fast Beep
Side of Bar	28 ft.	20 ft.	13 ft.
End of Bar	23 ft.	17 ft.	12 ft.

The energized bar is 4 feet long and 30 inches above the ground on insulators. It is energized from behind and the indicated voltage is line to ground.

For this test, the V-Watch Detector was worn on the shirt front as pictured. Warning distances will be reduced slightly if it is worn on the belt and will be reduced substantially if an arm is extended toward the energized source or if the user approaches the energized source backwards.

#### TERMS AND CONDITIONS OF SALE

HD Electric Company is benien referred to either as "MDC or "Saller" and the customer or person or entity purchasing goods or services (here under collective) perferred to as "Goods" is referred to as "Foods" in price and conditions, any price alor or shedule, qualition, astronologisment or invoice from MDC relevant to the sale of the Goods and all documents incorporated by specific reference therein, constitute the complete and exclusive statement of the terms of the agreement governing the sale of Goods by MDC is Buyer Buyer's acceptance of the Goods will manifest Buyer's assert to these terms and conditions without variation or addition. Any different or additional terms in Buyer's purchase order or other Buyer documents are hereby obligated, to ADDC reseaves the infort in its solid discorbing to refuse order.

1. PRICES AND TAXES: Unless a fixed price is quited, the price at which this order is accepted is subject to adjustment to HDEs price in felfect at the fixed order. Any current or fixed the time or order. Any current or fixed the time order and price order. Any current order fixed the time order and price order. Any current order fixed the time order and the subject order order. Any current order order and the subject order orde

2. TEMB OF PAYMENT: Term are stated on HDEs invoice in U.S. currency. HDE shall have the right, among other remedies, either to texture this agreement or to suspend further performance under this ander other agreements with the Buyer in the event Buyer fails to make any payment when due, which other agreements Buyer and Seller hereby amend accordingly, or HDE otherwise deems teller frescure. Buyer shall be lable for all expenses, including attorneys fises, relating to the collection of past due amounts. Should Buyer's financial responsibility become unsatisfication by HDE, cate hypermets or security satisfactory to HDE can be required by HDE for future deliveres and for the goods theretofroe delivered. If such cash payment or security is not provided, in addition to HDE's other rights and remedies, HDE may discontinue deliveries. HDE may apply a finance change for payments made by rardict cant.

3. SHIPMENT AND DELIVERY: Uhless otherwise expressly provided, shipments are made F.O.B. HDE's shipping point. Risk of loss or damage and responsibility shall pass from HDE to Buyer upon delivery to and receipt by common careful, roy dams for shrotspies or damages suffered in threats are the responsibility of Buyer and shall be submitted by the Buyer directly to the careful. Shortspies or damages must be acknowledged and signed for at the time of delivery. While HDE will use all reasonable commercial efforts to market to make partial shipments. HDE reserves the right to make partial shipments. HDE asknowledged or quoted by HDE, all shipping dates are approximate and not quaranteed. HDE reserves the right to make partial shipments. HDE asknowledged or quoted by HDE, all shipping shall not be bound to leader delivery of any Goods for which Buyer has not provided alphaging instructions. If the shipment other additional expenses resulting herefrom. All claims for shipping errors, lost shipments or any other discrepancies must be made within many (90) days or here will be featured and deemed waived.)

4. HDE LIMITED WARRANTY: HDE covers its products with a manufacturer's warranty against defects in material or workmarship for a princi of lare years in the case of Capacidor Controls and in all other circumstances for a period of lare years the case of Capacidor Controls and in all other circumstances for a period of lare years that the state of HDE or any HDE Authorized Service Control. This warranty shall not apply to any Cooks including but not limited to products which (of lare been respected or altered active HDE is factory for Authorized Service Control. Control Authorized Service Control. Control Lare Service Control. (of Hauthorized Service Control. Control Lare Service Control. Control Lare Service Control. (of Hauthorized Service Control. Control Lare Service Control.) (of Hauthorized Service Control. Control Lare Service Control International Control Lare Service Control Lare Service Control Lare Control Lare Service Control Lare Control

THE FORECOING CONSTITUTES HOË'S SOLE WARRANTY RESPONSIBILITY AND BUYER'S EXCLUSIVE REMEDY WHETHER SOUNDING IN TORT, CONTRACT, STRICT LIABILITY OR OTHERWISE, EXCEPT AS OTHERWISE EXPRESSLY SET FORTH IN THIS AGREEMENT. THERE ARE NO OTHER WARRANTIES, EXPRESS OR IMPLIED, WHETHER OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE. OR OTHERWISE. No employee, agent, dealer, or other person is authorized to give any warranty on behalf of HDE. This warranty estands only to persons or organizations how purbases the Goods from HDE for reaching.

5. LIMITATION OF REMEDY AND LIABILITY: THE SOLE AND EXCLUSIVE REMEDY FOR BREACH OF ANY WARRANTY HEREUNDER SHALL BE LIMITED TO REPAIR. CORRECTION, REPLACEMENT OR CREDIT UNDER SECTION 4, HDE SHALL NOT BE LIABLE FOR DAMAGES CAUSED BY DELAY IN PERFORMANCE, AND IN NO EVENT, REGARDLESS OF THE FORM OF THE CLAIM OR CAUSE OF ACTION (WHETHER BASED IN CONTRACT, INFRINGEMENT, NEGLIGENCE, STRICT LIABILITY, OTHER TORT OR OTHERWISE). SHALL HDE'S LIABILITY TO BUYER AND/OR ITS CUSTOMERS EXCEED THE PRICE PAID BY BUYER FOR THE SPECIFIC GOODS GIVING RISE TO THE CLAIM OR CAUSE OF ACTION, AND BUYER SHALL INDEMNIFY HDE FOR ANY DAMAGES IN EXCESS THEREOF, BUYER AGREES THAT IN NO EVENT SHALL HDE'S LIABILITY TO BUYER AND/OR ITS CUSTOMERS INCLUDE SPECIAL, INDIRECT. INCIDENTAL, CONSEQUENTIAL OR PUNITIVE DAMAGES OF ANY CHARACTER IN CONNECTION WITH THE SALE, RE-SALE OR USE OF THE GOODS, WHICH ARE WAIVED BY BUYER AND AS TO WHICH BUYER SHALL INDEMNIFY HDE. The term "consequential damages" shall include, but not be limited to, loss of anticipated profits, business interruption, loss of use of revenue, cost of capital or loss of or damage to property, equipment, or data, or loss of reputation. Further, Buyer shall indemnify and hold HDE harmless from any liability to Buyer, Buyer's employees, workers, contractors or any other persons arising out of Buyer's, and any other persons', use of the Goods. All instructions and warnings supplied by HDE will be passed on to those persons who use the Goods. HDE's Goods are to be used in their recommended applications and all warning labels adhered to the Goods by HDE shall be left intact. It is impossible to eliminate all risks associated with the use of the Goods. Risks of serious injury or death, including risks associated with electrocution, arcing and thermal burns, are inherent in work in and around energized electrical systems. Such risks arise from the wide variety of electrical systems and equipment to which Goods may be applied, the manner of use or application, weather and environmental conditions or other unknown factors, all of which are beyond the control of HDE. HDE does not agree to be an insurer of these risks, and shall have no liability for any claims arising from such risks. WHEN YOU BUY OR USE THESE PRODUCTS, YOU AGREE TO ACCEPT THESE RISKS.

6. EXCUSE OF PERFORMANCE (FORCE MAJEURE): HDE shall not be lable for delays in performance or for non-performance due to ack of God, acts of Bloys, war fire thood, veathers, aslobcage, sinks, allordations, a fold-distandence or first or governmental equalest, restrictions, allocations, laws, regulations, orders or actions, unavailability of or delays in transportation; default of suppliers; or unforeseen circumstances or events beyond HDE: assessmale control. Deleviers or or their performance may be suspended for an appropriate priori or cancelled by HDE upon motion to buyer in the event of any of the foregoing, but the balance of this agreement shall otherwise remain unaffected. If HDE delets is the control of the suppliers of

- 7. CHANGES: HDE reserves the right to change designs and specifications for standard Goods without prior notice to Buyer, but not with respect to custom Goods being made for Buyer. HDE shall have no obligation to install or make such change in any Goods manufactured prior to the date of such change.
- 8. ASSIGNMENT: Buyer shall not assign its rights or delegate its duties hereunder or any interest herein without the prior written consent of HDE, and any such assignment, without such consent, shall be void.
- 9. INSTALLATION: Buyer shall be responsible for receiving, inspecting, testing, storing, installing, starting up and maintaining all Goods.
- 10. NSPECTION/TESTING: Buyer, at its expense, agness that it will promptly inspect the Goods upon receipt thereof, and in no event later than thirty (30) quies from the date of receipt of the Goods. Buyer shall deliver to Irls with infleen (15) days of respection, but in no event later than forty-five (45) days from the date of receipt of the Goods, written notice of any and all deficiencies, defects, variations from specifications or complaints of any invited with respect to the quartity, quality, coulding, voluming, and the specimens or the Goods are considered by Bibury. In the event no such written notice is received by HDE; Buyer shall be deemed conclusively to have inspected and accepted all such that of the control of the co
- 11. SERVICES: If this agreement requires HDE to perform or provide any services, HDE (including without limitation its successors, assigns, agents or any person or entity acting at HDE's direction) shall not be responsible for any damages, claims, liabilities or expenses of any nature arising nut of such sensions.
- 12. U.S. EXPORT CONTROL LAWS: All Goods sold to Buyer by HDE hereunder are subject to U.S. Export Control Laws. Buyer hereby agrees not to re-sell or divert any goods contrary to such laws.
- 13. COMPLANCE: Selent/Contractor shall comply with all applicable federal, stake or local taws, rules, regulations, or orders. Selent/Contractor shall comply with Executive Order 11246, as amended by Executive Order 11376, and the applicable provisions of the Office of Federal Contract Compliance Programs (OFCCP), 41 CPR Part 50, which are incorporated herein by this reference. Buyer shall comply with all applicable federal, state, or local laws, rules, regulations or orders including but not limited to the Foreign Corrupt Practices Act of 1977, as amended. HICP reserves the input to delay or reflexe delety of requests for reasonable assurances of Buyer's compliance are not tendenced as requested.
- 14. MISCELLANEOUS: These terms and conditions supersede all other communications, negotiations and prior crait or written statements requiring the subject matter hereoft. No changes, modification, rescission, discharge, advandoment, or valver of these terms and conditions shall be binding upon HDE unless made in writing and signed on its behalf by its duly authorized representative. No conditions, usage or trade, course of desting or performance, understanding or agreement purporting) to modification shall be binding unless hereafter made in writing and signed by Seller. No modification shall be lefficied by HDEs receipt or acceptance of buyer is purchase orders, shipping instruction forms, of their counterstation containing items at variance with or is addition to those self forth herein, at of which are objected to by HDE. Any such modifications or additional terms are specifically rejected by HDEs where the self-seller is a contained to the self-seller in the self-seller is a contained to the self-seller in the seller in the self-seller in the seller in the seller in the self-seller in the self-seller in the seller in the self-seller in the seller in the seller in the self-seller in the self-seller in the self-seller in the seller in the sell
- 15. DISPUTE RESOLUTION: In the event of any dispute INCLUDING, BUT NOT LIMITED TO, BREACH OF CONTRACT, BREACH OF WARRANTY CLAMBS ASSED IN TORT NCSULGENCE PRODUCT LIBILITY FRAUD MARKETING, STATE OR REPERFAL RESULATIONS, ANY CLAMBS REGARDING THE ENFORCEABILITY OF THIS LIMITED WARRANTY, AND THE WAVER OF CLASS ACTION TRACT. ALS between Buyer and Saler, either may donce to resolve the dispute by brinding abritation, as described below, instead of in out. THIS MEANS FETHER BUYER OR SELLER CHOOSE BINDING ARBITRATION NETHER PRATTY SHALL HAVE THE RIGHT TO LITIGATE SUCH CLAMB NO COUNT OR HAVE A LAUTY TRAL DISCOVERY AND APPEAR INFORM SELLER discovering and Seller agree that the proper venue if Arbitration is not so chosen by Buyer or Seller of all actions arising in connection herewith shall be only in the state of liticions and the parties agree to submit to such jurisdiction. No action, regardless of form, arising up of transactions relating to the agreement, may be brought by either party more than two (2) years after the cause of action has accrued. The U.N. Convention on Contracts for the International Selses of Goods shall not apply to this agreement.
- 16. CLASS ACTION WANVER: BINDING ABBITRATION MUST BE ON AN INDIVIDUAL BASIS. THIS MEANS NETHER BUYER NOR SELLERMAY, SOIN OR CONSOLIDATE CLAIMS IN ABBITRATION BY OR AGAINST OTHERS, OR INTIGATE IN COURT OF ABBITRATE ANY CLAIMS AS A REPRESENTATIVE OR MEMBER OF A CLASS OR IN A PRIVATE ATTORNEY GENERAL CAPACITY. ADMINISTRA-ANY CLAIMS AS A REPRESENTATIVE OR MEMBER OF A CLASS OR IN A PRIVATE ATTORNEY GENERAL CAPACITY. ADMINISTRA-TION OF ARBITRATION. The binding attribution must be administed by the American Arbitration Association ("AAA") in accordance with its Commercial Arbitration Rules and/or Supplementary Procedures for Consumer-Related Disputes (including proceedings to mitigate costs of tresult. This binding arbitration is operand by the Federal Arbitration Act ("FAA") (195.5 §1, et. seq.) and vial growed in growed in addition to the tresult stated above, the following will apply to the binding attribution (1) the arbitration (1) the arbitration, and not any federal, state, or local court or agency, will have exclusive authority to resolve any dispute relating to the interpretation, applicability, enforcability or formation of this Agreement including any claim that all or any part of this Agreement is void or voidsket, (2) the arbitrate val apply lilinois less consistent with the FA.
- HD Electric Company is committed to ongoing review and improvement of its product lines, and thus reserves the right to modify product design and specifications without notice.
- HD Electric Company® products are available through HDE® sales representatives worldwide.
  HD Electric products receive final assembly and shipment from HDE's production facility at
  Suite 400 4320 Executive Drive, Southaven, MS 38672.

HD Electric Company is ISO 9001:2015 certified